


FOR PERMANENT ASPHALT REPAIR, COLD
PLAN 2" MIN. AND CONSTRUCT TYPE C2 PG
64-10 ASPHALT CONCRETE

** THE 2" GRIND SHALL
BE 12' WIDE FOR
TRENCHES LONGER
THAN 300'

EX. BASE MATERIAL

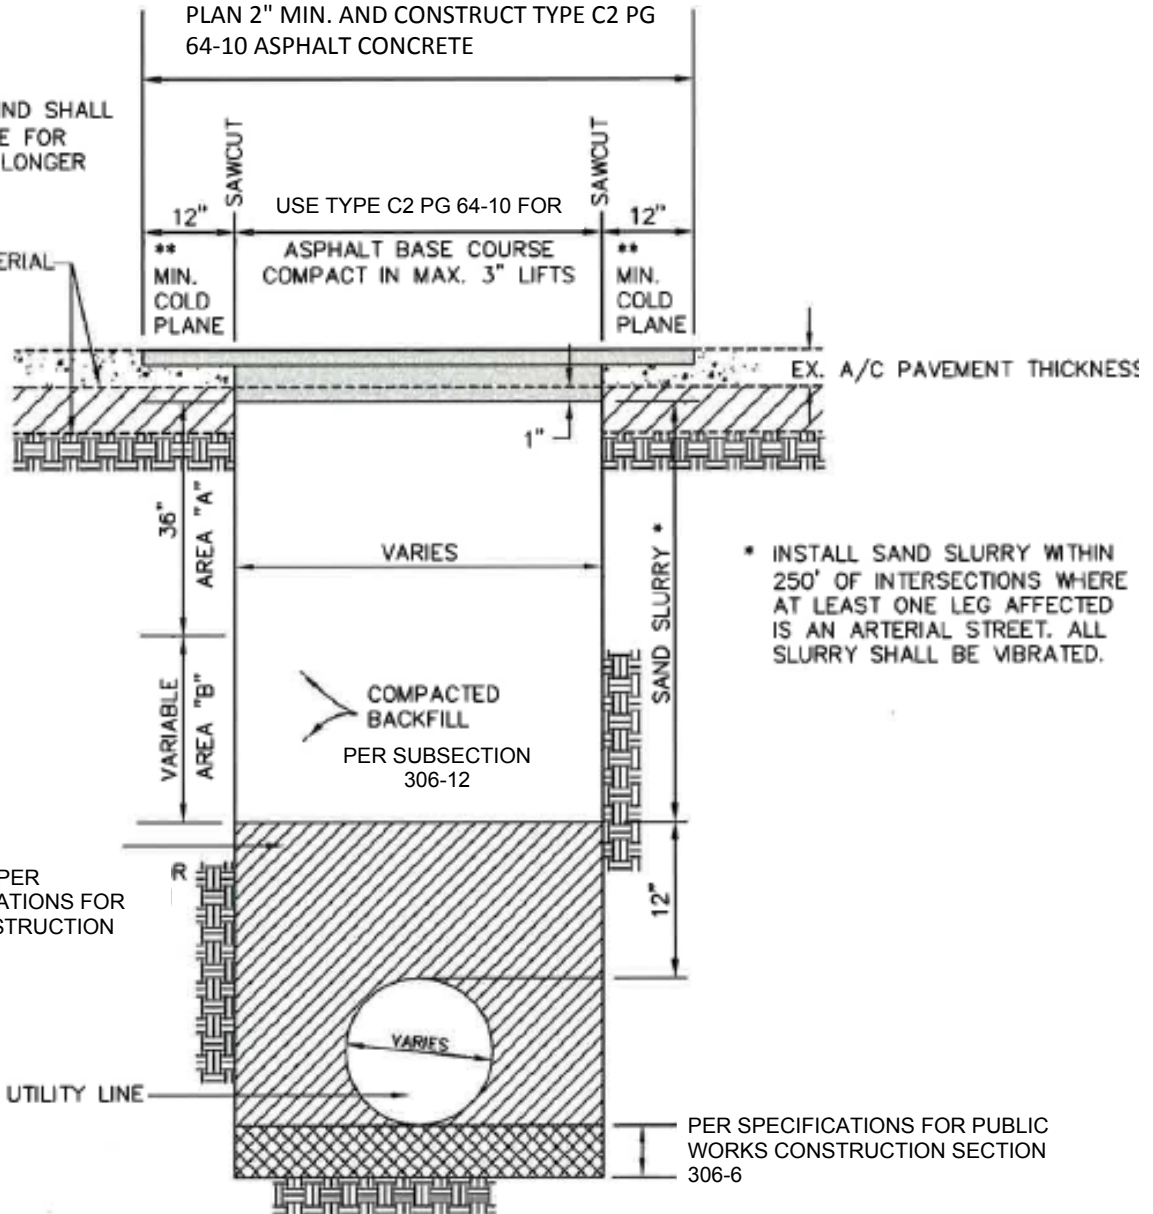

* INSTALL SAND SLURRY WITHIN
250' OF INTERSECTIONS WHERE
AT LEAST ONE LEG AFFECTED
IS AN ARTERIAL STREET. ALL
SLURRY SHALL BE VIBRATED.

PIPE ZONE BEDDING PER
STANDARD SPECIFICATIONS FOR
PUBLIC WORKS CONSTRUCTION
SECTION 306-6

PER SPECIFICATIONS FOR PUBLIC
WORKS CONSTRUCTION SECTION
306-6

AREA "A" BACKFILL SHALL BE 1-1/2 SACK SAND SLURRY OR AGGREGATE BASE. IF
AGGREGATE BASE IS USED IT SHALL BE MECHANICALLY COMPACTED TO 95%
RELATIVE COMPACTION. (SEE "*" NOTE FOR INTERSECTIONS).

AREA "B" BACKFILL NATIVE OR IMPORT MATERIAL WITH SAND EQUIVALENT OF AT LEAST 20.
MECHANICALLY COMPACTED TO 90% RELATIVE COMPACTION. (SEE "*" NOTE FOR
INTERSECTIONS).

TEMPORARY AND PERMANENT TRENCH RESURFACING SHALL BE IN
ACCORDANCE WITH SUBSTATION 306-13 OF THE STANDARD SPECIFICATION
FOR PUBLIC WORKS CONSTRUCTION (GREEN BOOK).

CONSTRUCTION OF UTILITY
TRENCHES IN EXISTING
STREETS AND ALLEYS

CITY OF PALOS VERDES ESTATES

P.V.E. STD. PLAN